



**PLAN**

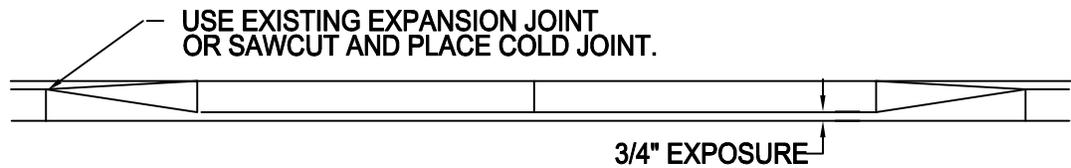

**ELEVATION**

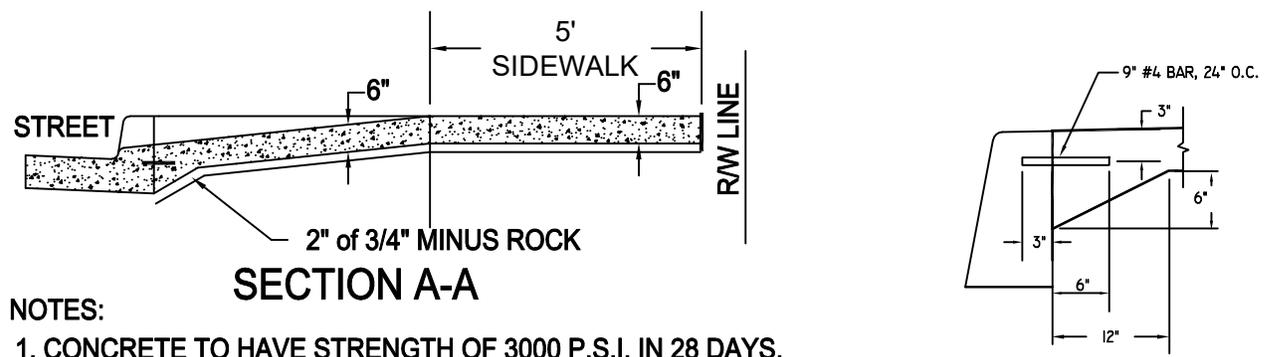

**SECTION A-A**

- NOTES:**
1. CONCRETE TO HAVE STRENGTH OF 3000 P.S.I. IN 28 DAYS.
  2. CURB JOINT SHALL BE A TROWELED JOINT WITH A MINIMUM 1/2" RADIUS ALONG BACK OF CURB.
  3. ISOLATION JOINTS SHALL BE 1/2" PREMOLDED ASPHALT IMPREGNATED MATERIAL EXTENDING FROM SUBGRADE TO FINISHED GRADE, NO WOOD PRODUCTS ALLOWED.
  4. EXPANSION JOINT SPACING SHALL BE A MAXIMUM OF 12'.
  5. SUB GRADE SHALL BE FIRM WITH NO SOFT SPOTS WITH A MINIMUM OF 2" OF 3/4-0" ROCK.
  6. STEEL TIES 9" LONG DRILL HOLE 3" INTO EXISTING CURB 4# BAR 24" ON CENTER.
  7. UP TO 30' MAX. WHEN MEETING SPECIAL REQ'S OF SEC. 17.8.130 OF

<p style="font-size: 24pt; font-weight: bold;">FOREST GROVE OREGON</p>	<p style="font-size: 18pt; font-weight: bold;">RESIDENTIAL DRIVEWAY (PROPERTY LINE SIDEWALK)</p>	<p style="font-size: 10pt;">ENGINEERING DEPARTMENT 1924 COUNCIL STREET P.O. BOX 326 FOREST GROVE, OR 97116</p>	<p style="font-size: 12pt;">DRAWING NO. <b>111</b></p>
	<p style="font-size: 10pt;">\\w2kleng\Eng Dept\STANDARD DETAILS\100s SIDEWALKS\RESIDENTIAL DRIVEWAY PROPERTY LINE.dwg</p>		<p style="font-size: 12pt;">SCALE <b>NONE</b></p>
			<p style="font-size: 10pt;">LAST REV. 12/2/24</p>