



**PLAN**

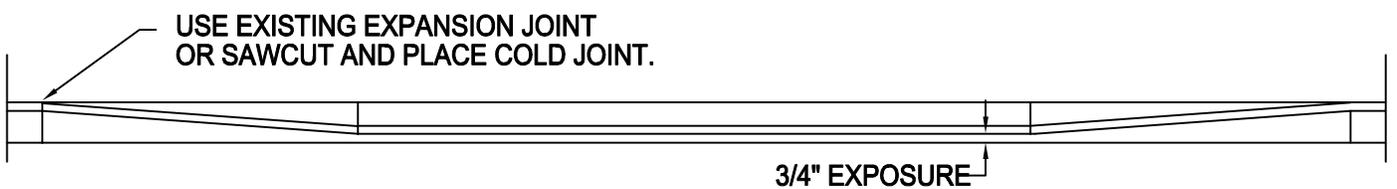

**ELEVATION**

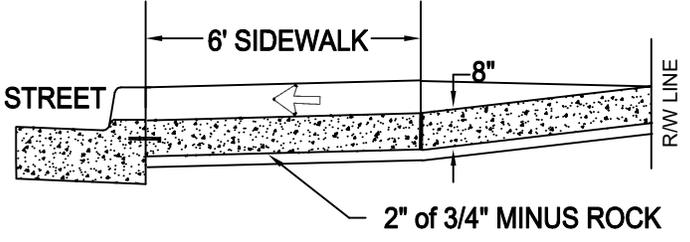

**SECTION A-A**

**NOTES:**

1. CONCRETE TO HAVE STRENGTH OF 3000 P.S.I. IN 28 DAYS.
2. CURB JOINT SHALL BE A TROWELED JOINT WITH A MINIMUM 1/2" RADIUS ALONG BACK OF CURB.
3. ISOLATION JOINTS SHALL BE 1/2" PREMOLDED ASPHALT IMPREGNATED MATERIAL OR EQUAL EXTENDING FROM SUBGRADE TO FINISHED GRADE.
4. EXPANSION JOINT SPACING SHALL BE A MAXIMUM OF 12'.
5. SUB GRADE SHALL BE FIRM WITH NO SOFT SPOTS WITH A MINIMUM OF 2" OF 3/4-0" ROCK
6. STEEL TIES 9" LONG, DRILL HOLES 3" DEEP INTO EXISTING CURB, INSTALL #4 REBAR 24" ON CENTER.

**LEGEND:**

- ↓ CROSS SLOPE 1.5% MAX (MAX 2.0 % FINISHED SURFACE SLOPE)
- ← RUNNING SLOPE 7.5% MAX (MAX 8.3% FINISHED SURFACE SLOPE)



NON-RESIDENTIAL DRIVEWAY  
(CURBSIDE SIDEWALK)

ENGINEERING DEPARTMENT  
1924 COUNCIL STREET  
P.O. BOX 326  
FOREST GROVE, OR 97116

DRAWING NO.  
**107**

SCALE  
**NONE**