
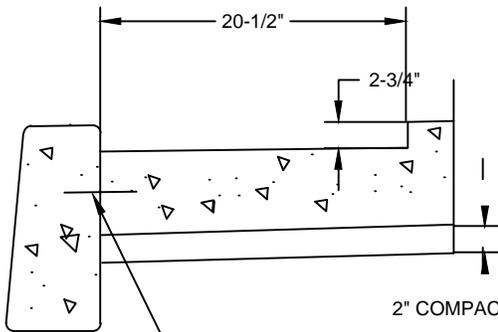


BRICK PAVER

mutual materials
burgundy "mica - tile"

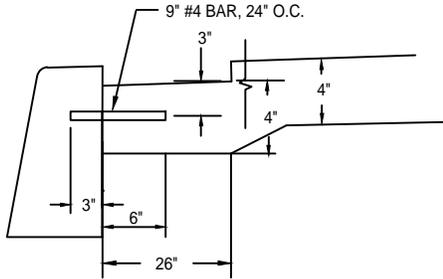

2" COMPACTED AGGR.

DOWEL SIDEWALK TO CURB
PER STANDARD DETAIL FOR
DOWELING SIDEWALKS



USE MORTAR BED TO ADJUST
BRICKS FLUSH TO TOP OF CURB
AND SIDEWALK

DEEP TOOL JOINTS
SHALL LINE UP WITH
JOINTS IN CURB

5 rows of brick with
1/2" grout seams.
provide expansion at
max. 30' intervals.

5' X 5' NOM.
TREE WELL

DEEP
TOOL
JOINT
1/4 OF
THICKNESS
OF
CONCRETE

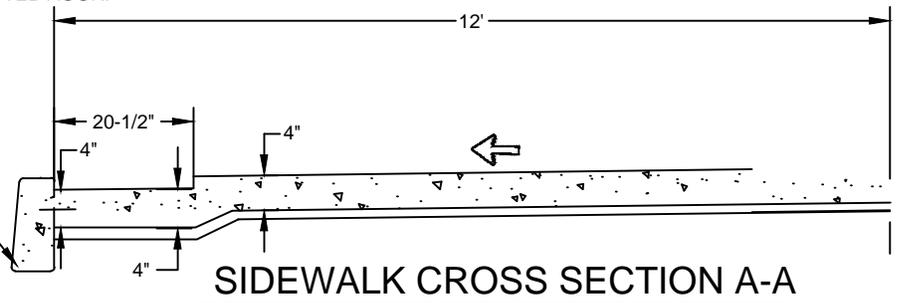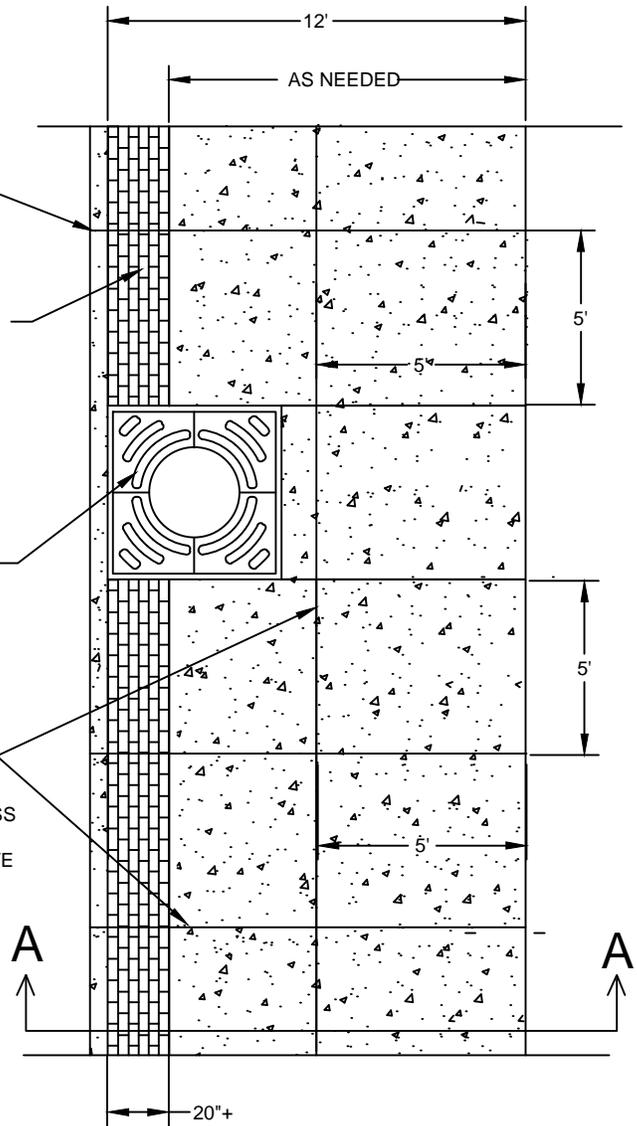


SIDEWALK CROSS SECTION A-A

NOTES:

1. CONCRETE TO REACH STRENGTH OF 3000 P.S.I. IN 28 DAYS 2" TO 4" SLUMP.
2. EXPANSION JOINTS TO BE PLACED AT SIDES OF DRIVEWAY APPROACHES, UTILITY VAULTS & AT SPACING NOT TO EXCEED 90' OR AS DIRECTED BY THE ENGINEER.
3. FOR SIDEWALKS ADJACENT TO THE CURB & POURED AT THE SAME TIME AS THE CURB . THE JOINT BETWEEN THEM SHALL BE A TROWELED JOINT WITH A MIN. 1/2" RADIUS.
4. DRAIN BLOCKOUTS IN CURBS SHALL BE EXTENDED TO BACK OF SIDEWALK WITH 3" DIA. SCH. 40 ABS OR PVC PIPE AT 2% SLOPE, CONTRACTION JOINT TO BE PLACED OVER PIPE.

LEGEND:

↓ CROSS SLOPE 1.5% MAX (MAX 2.0 % FINISHED SURFACE SLOPE)

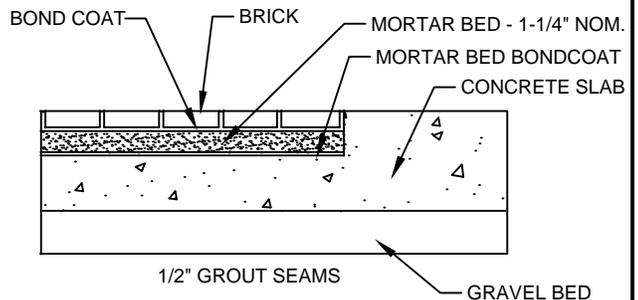

**DOWNTOWN
BRICK SIDEWALK**

ENGINEERING
DEPARTMENT
1924 COUNCIL STREET
P.O. BOX 326
FOREST GROVE, OR 97116

DRAWING NO.
104

SCALE
NONE

LAST REV. 7/20/22