


TAPERED 2"x4" KEYWAY TO BE FORMED INTO CURB AS SHOWN WHERE CURB & SIDEWALK WILL NOT BE POURED AT THE SAME TIME.

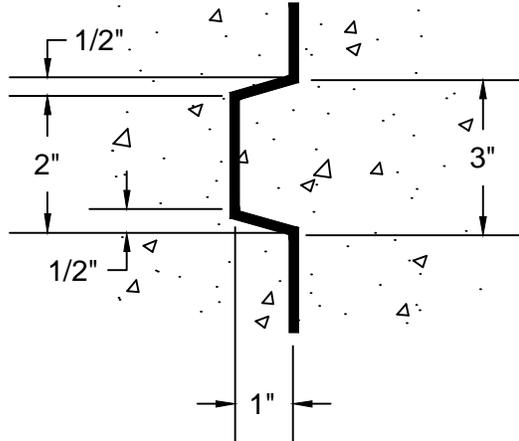

KEYWAY

NOTES:

1. CONCRETE TO HAVE STRENGTH OF 3000 P.S.I. IN 28 DAYS 2" TO 4" SLUMP.
2. KEYED COMBINATION CURB & SIDEWALK WILL ONLY BE PERMITTED TO BE USED WHEN THE ENGINEER DETERMINES THAT IT IS NOT FEASIBLE TO CONSTRUCT MONOLITHIC COMBINATION CURB & SIDEWALK.
3. PANELS TO BE 5 FEET LONG
4. EXPANSION JOINTS TO BE PLACED AT SIDES OF DRIVEWAY APPROACHES, UTILITY VAULTS & AT SPACING NOT TO EXCEED 90' OR AS DIRECTED BY THE ENGINEER.
5. FOR SIDEWALKS ADJACENT TO THE CURB & POURED AT THE SAME TIME AS THE CURB . THE JOINT BETWEEN THEM SHALL BE A TROWELED JOINT WITH A MIN. 1/2" RADIUS.
6. DRAIN BLOCKOUTS IN CURBS SHALL BE EXTENDED TO BACK OF SIDEWALK WITH 3" DIA. SCH. 40 ABS OR PVC PIPE AT 2% SLOPE, CONTRACTION JOINT TO BE PLACED OVER PIPE.

LEGEND:

↓ CROSS SLOPE 1.5% MAX (MAX 2.0 % FINISHED SURFACE SLOPE)

	KEYED COMBINATION CURB & SIDEWALK	ENGINEERING DEPARTMENT 1924 COUNCIL STREET P.O. BOX 326 FOREST GROVE, OR 97116	DRAWING NO. 106
		SCALE NONE	LAST REV. 7/20/22