


SIDE VIEW

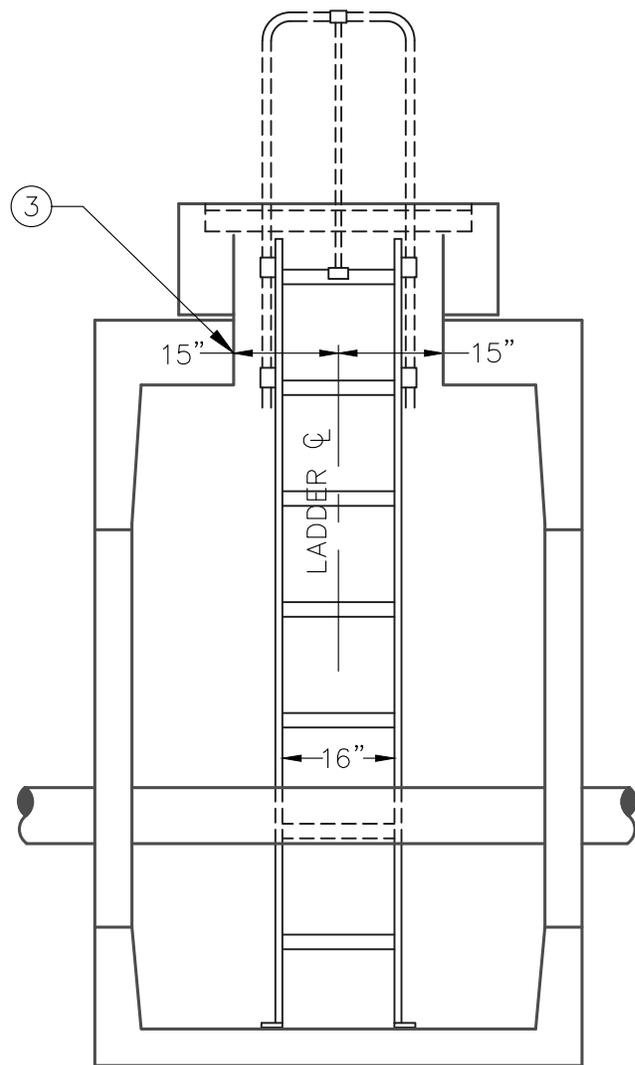

FRONT VIEW

KEYNOTES:

- ① LADDER EXTENSION SHALL BE ALUMINUM AND EXTEND 40" ABOVE THE TOP RUNG OF THE LADDER. EXTENSION SHALL BE BOLTED UP BEHIND LADDER RUNGS.
- ② ATTACH LADDER SUPPORT TO INSIDE FACE OF VAULT OPENING AND FLOOR OF VAULT WITH STAINLESS STEEL HARDWARE AS SHOWN. \varnothing OF RUNG MUST BE SET 7" FROM FACE OF SURFACE BEHIND RUNG.
- ③ PROVIDE 15" MINIMUM LATERAL CLEARANCE ON EACH SIDE OF LADDER \varnothing .
- ④ LADDER SHALL MEET THE REQUIREMENTS OF OSHA AND SHALL BE HOT-DIPPED GALVANIZED AFTER FABRICATION.